DRAWING NO.
SU1920-38

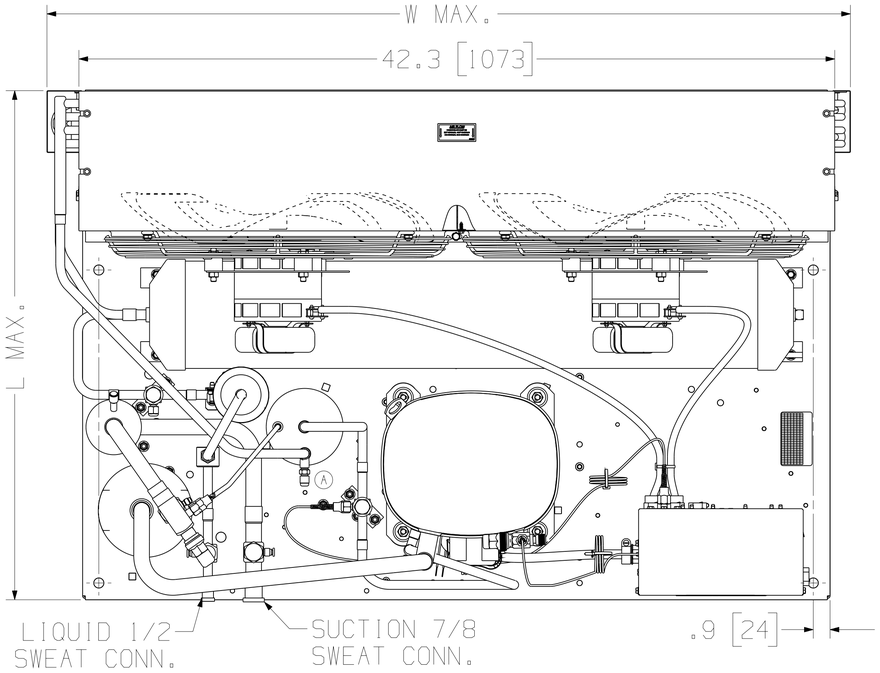


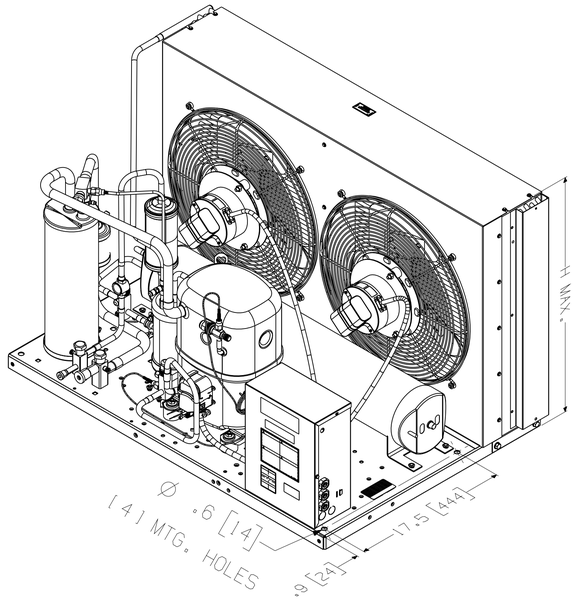


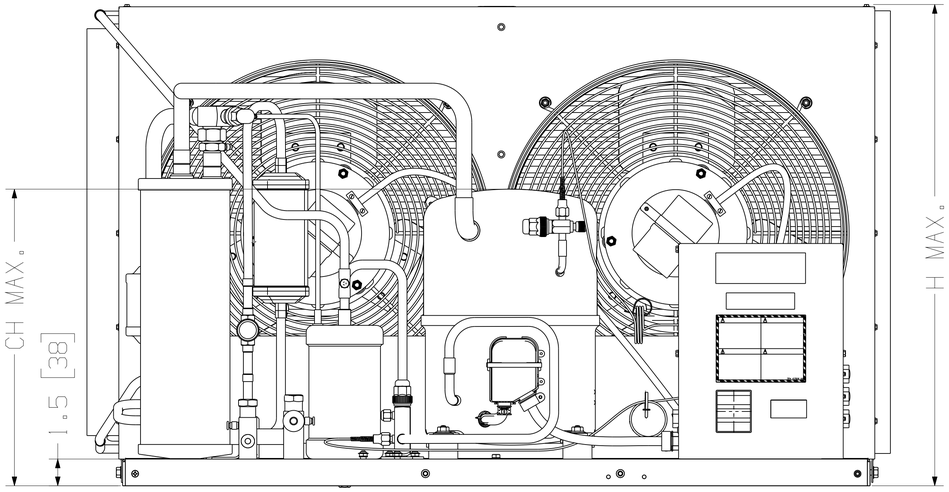


| L | W | H | CH |
|---|---|---|---|
| 28.5 [723] | 44.9 [1141] | 26.9 [683] | 16.6 [421] |

NOTE:

DIMENSIONING = INCHES [MILLIMETERS]

3D,VNX6

ENGLISH

O.A. SYMBOLS
✱ = CATEGORY I
▲ = CATEGORY II
■ = CATEGORY III
= CATEGORY IV

AV

| REL | -- | EC36851 | TS 23FEB11 |
|---|---|---|---|
| LT | LC | CHANGE | DATE |

A 10F1

FROM 2PVP TO 2PVN PRODUCTS THE CRANKCASE HEATER WILL BE FACTORY INSTALLED AND CONNECTED. THE CRANKCASE HEATER IS REQUIRED FOR ALL OUTDOOR APPLICATIONS AND WHEN IT IS LIKELY THAT LIQUID REFRIGERANT WILL MIGRATE TO THE CRANKCASE DURING THE OFF CYCLE. FOR MORE INFORMATION ON CRANKCASE HEATERS AND THEIR INSTALLATION REQUIREMENTS, REFER TO SERVICE BULLETIN 99-03. THIS BULLETIN CAN BE FOUND ON THE TECUMSEH WEB SITE AT WWW.TECUMSEH.COM UNDER LITERATURE, SERVICE BULLETINS. ALSO, REFER TO THE INSTALLATION INSTRUCTIONS SUPPLIED WITH THE CRANKCASE HEATER FOR ADDITIONAL INFORMATION AND DO NOT ENERGIZE IT UNTIL ALL REFRIGERANT LINES HAVE BEEN CONNECTED AND LEAK TESTED. IF THE CRANKCASE HEATER IS NOT ENERGIZED FOR AT LEAST 8 HOURS PRIOR TO START-UP, EXTENDED COMPRESSOR LIFE MAY BE AFFECTED.

CF2984
ADDED OIL CHARGE LIMITS AT OIL SEPARATOR

DO NOT SCALE THIS DRAWING. DIMENSIONS MAY NOT REFLECT ACTUAL MATERIAL USED. DIMENSIONS ARE REQUIRED FOR ALL CONTROL DRAWINGS.

DIS.CODE --

NAME HERMETIC CONDENSING UNIT

| DWN. | CK. | APR. | SCALE | THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO |
|---|---|---|---|---|
| TS 02FEB11 | ON FILE | ON FILE | 1:4 & NOTED | |

TECUMSEH PRODUCTS CO.
ANN ARBOR, MICHIGAN

DRAWING NO. SU1920-38

MATERIAL NOTED

BANNER